



INVESTOR IN PEOPLE

Holbrook House, Little Waldingfield,
Sudbury, Suffolk CO10 0TH
Tel: (01787) 247595
e-mail: srl@srltsl.com

Contract: C/21751

Page: 1 of 1

Date: 24 April 2012

Confidential


See SRL report C/21751/4 for full details

The Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

Client: Rockwool Asia, Rockwool (Hong Kong) Ltd
Test Date: 21/09/2011
Empty Room: Temperature: 17.8 °C Humidity: 68 %RH Pressure: 1010 mbar
Room with Sample: Temperature: 17.8 °C Humidity: 68 %RH Pressure: 1010 mbar
Sample
Description: ThermalRock S40 1200x600x50mm 40kg/m³
Mounting Method: A
Sample Area: 10.8 m²
Chamber Volume: 300 m³

Sound Absorption Coefficient

Test 16				
Freq Hz	T1 sec	T2 sec	Absorp Coeff	Practical Absorp Coeff #
50*	4.45	4.26	0.05	
63*	4.73	4.77	-0.01	n/a
80*	5.76	5.28	0.07	
100	7.97	6.72	0.10	
125	8.21	5.90	0.21	0.20
160	7.93	4.93	0.34	
200	7.61	4.39	0.43	
250	7.95	3.88	0.59	0.60
315	7.72	3.30	0.78	
400	6.86	2.81	0.94	
500	5.66	2.40	1.08	1.00
630	5.22	2.29	1.10	
800	5.69	2.37	1.11	
1000	6.33	2.45	1.12	1.00
1250	6.14	2.47	1.09	
1600	5.60	2.36	1.10	
2000	5.18	2.26	1.12	1.00
2500	4.63	2.17	1.10	
3150	3.93	1.99	1.12	
4000	3.30	1.78	1.16	1.00
5000	2.64	1.59	1.12	
6300*	2.01	1.34	1.12	
8000*	1.71	1.19	1.15	n/a
10000*	1.18	0.91	1.13	
<i>A_w</i> 0.90				
Class A				
Calculated to EN ISO 11654:1997				
NRC 1.00				
Calculated to ASTM C 423-01				
* Denotes frequencies outside the range covered by BS EN ISO 354:2003				
T1, empty room reverberation time				
T2, room reverberation time with sample				

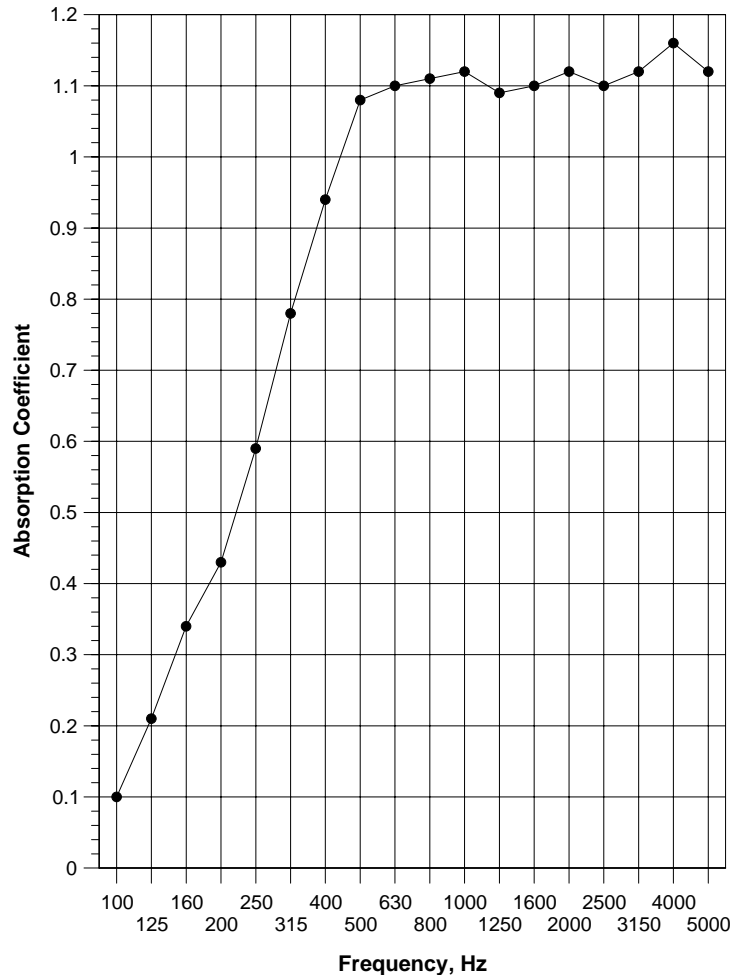

Practical absorption coefficient, BS EN ISO 11654:1997

v3.2